


FOR PROPERTIES WITH WATER WELLS WITHIN INVESTIGATION AREAS:

- 1. BOTTLED WATER AND WATER WELL TESTING OFFERED**
- 2. WHOLE HOUSE AND/OR POINT OF USE FILTERS OFFERED TO ALL WITH PFOS / PFOA DETECTIONS**

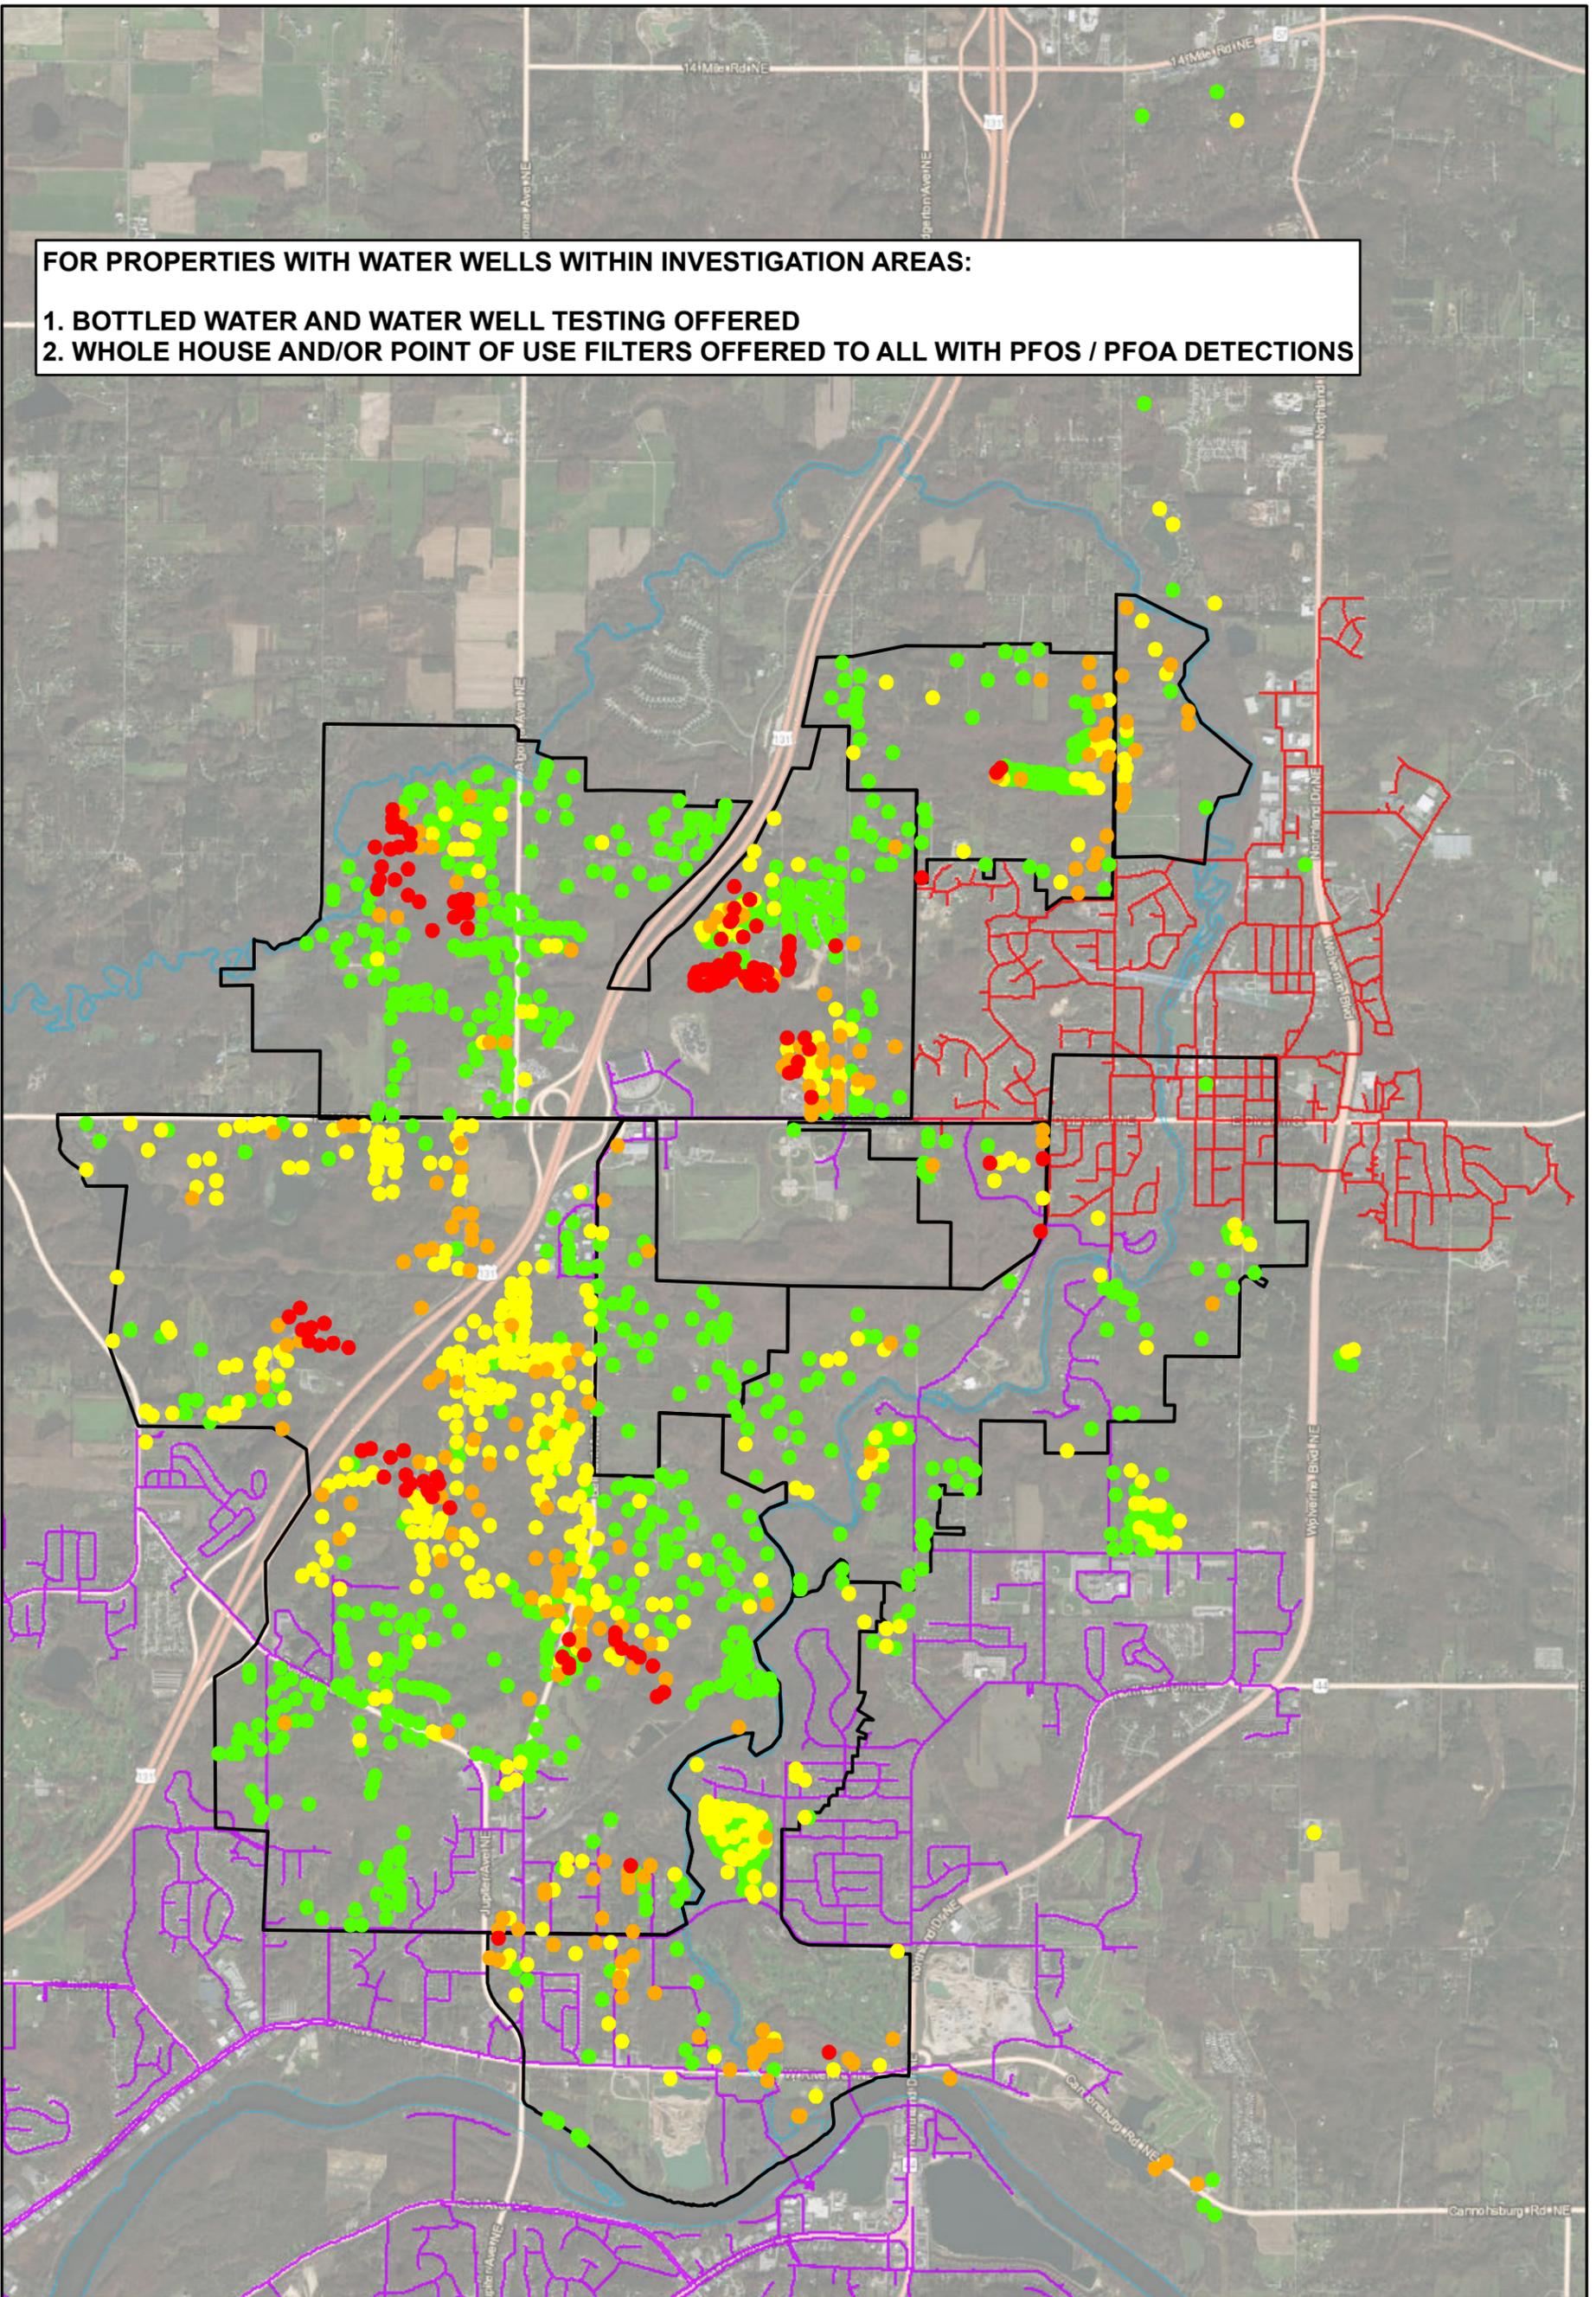

 <p>Prepared: 6/1/2018</p>	<p>Map Location</p> 	<p>Legend</p> <p>PFOS + PFOA, ppt (1,632)</p> <ul style="list-style-type: none"> ● Non-Detect (868) ● >0 to 10 (451) ● >10 to 70 (197) ● > 70 (116) <ul style="list-style-type: none"> — Rockford Municipal Water Lines — Plainfield Municipal Water Lines □ House, Wolvern/Jewell, Rogue, North Childsdale, 12 Mile & Summit, and North Kent Landfill Investigation Areas <p>0 0.5 1 Miles</p>	<p style="text-align: center;">DRAFT</p> <p style="text-align: center;">MAXIMUM DETECTED PFOS + PFOA CONCENTRATIONS AS OF 5/30/2018</p> <p style="text-align: center;">NORTH KENT DISPOSAL AREA KENT COUNTY, MI</p>
---	---	---	--